


NOTE:

- TOP OF 4' TAPER SHALL BE 1' MIN. FROM LOT LINE EXTENDED
- EACH DRIVEWAY PANEL NOT TO EXCEED 100 SF.
- REINFORCEMENT BARS OR WELDED WIRE FABRIC (STEEL MESH) ARE NOT ALLOWED IN THE RIGHT-OF-WAY
- CLASS 5 AGGREGATE BASE REQUIRED UNDER CURB AND GUTTER.
- PAVERS SHALL NOT BE INSTALLED THROUGH SIDEWALK.
- EXPANSION JOINTS NOT REQUIRED ADJACENT TO PAVERS.

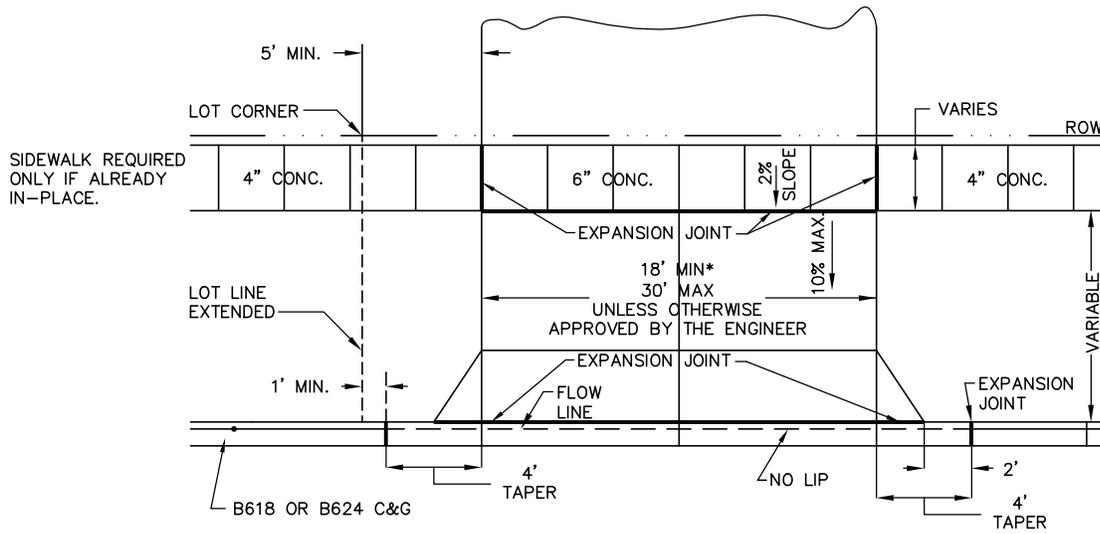

* FOR NEW DRIVEWAY APPROACH LOCATIONS ONLY. THIS DOES NOT APPLY TO REPLACEMENT OR OVERLAY OF EXISTING DRIVEWAYS

103 - RESIDENTIAL DRIVEWAY APPROACH WITH BOULEVARD SIDEWALK

103 - Drwy (Residential w-Walk).dwg 5/2015

H:\Cad_Comm\Details Updated\0 - STREET\103 - Drwy (Residential w-Walk)



**ENGINEERING DIVISION
PUBLIC WORKS DEPARTMENT**

PLATE NAME:

103 - Drwy (Residential w-Walk)

LAST REVISED: 6/5/2015

LAST REVISED BY: KBO